



GENERAL NOTES	
BASIN DATA (PER MODULE):	
MIN/MAX GPM RANGE	- 600/1800
ACTUAL GPM	-
HOT WATER TEMP F°	-
COLD WATER TEMP F°	-
WET BULB TEMP F°	-
MOTOR DATA (PER MODULE):	
BRAND	- BALDOR (OR EQUIV.)
EFFICIENCY	- HIGH
HP	- 3.0 / 5.0 / 7.5
KW	- 2.2 / 3.7 / 5.6
VOLTAGE	- 200 / 230 / 460 / 575
HZ	- 60
PHASE	- 3
NUMBER	- 6
POWER FACTOR	- .61 / .63 / .68
WEIGHTS (PER MODULE):	
DRY SHIPPING WEIGHT -	10,775 lbs, - 4,887 kg
OPERATING WEIGHT -	19,587 lbs, - 8,903 kg

- NOTES:
1. ALL EXTERNAL PIPING PROVIDED BY CUSTOMER.
  2. EXTERNAL PIPING TO BE "STAND ALONE" (INDEPENDENTLY SUPPORTED. FINAL CONNECTIONS TO THE COOLING TOWER MODULE MUST BE FIELD FITTED AFTER TOWER INSTALLATION TO PREVENT PIPE STRESS ON TOWER.
  3. NO LOAD TO BE APPLIED TO TOWER TECH TOWER OR SUMP.
  4. FOR APPROPRIATE WATER LEVEL REFER TO STARTUP SECTION IN TOWER TECH'S DESIGN, INSTALLATION & OPERATION MANUAL.
  5. MAKE-UP CONNECTION/FLOAT VALVE CONNECTION FLANGE IS MADE FROM HIGH QUALITY PLASTIC TO ELIMINATE CORROSION.
  6. THE MAXIMUM MAKE-UP INLET PRESSURE IS 25 PSIG. WHEN USING A MECHANICAL FLOAT VALVE, FLOAT VALVE MAY NOT SHUT OFF AGAINST HIGHER PRESSURES.
- \* THERE ARE NO MAXIMUM PRESSURE REQUIREMENTS WHEN USING ELECTRONIC LEVEL CONTROL AND A SOLENOID VALVE.

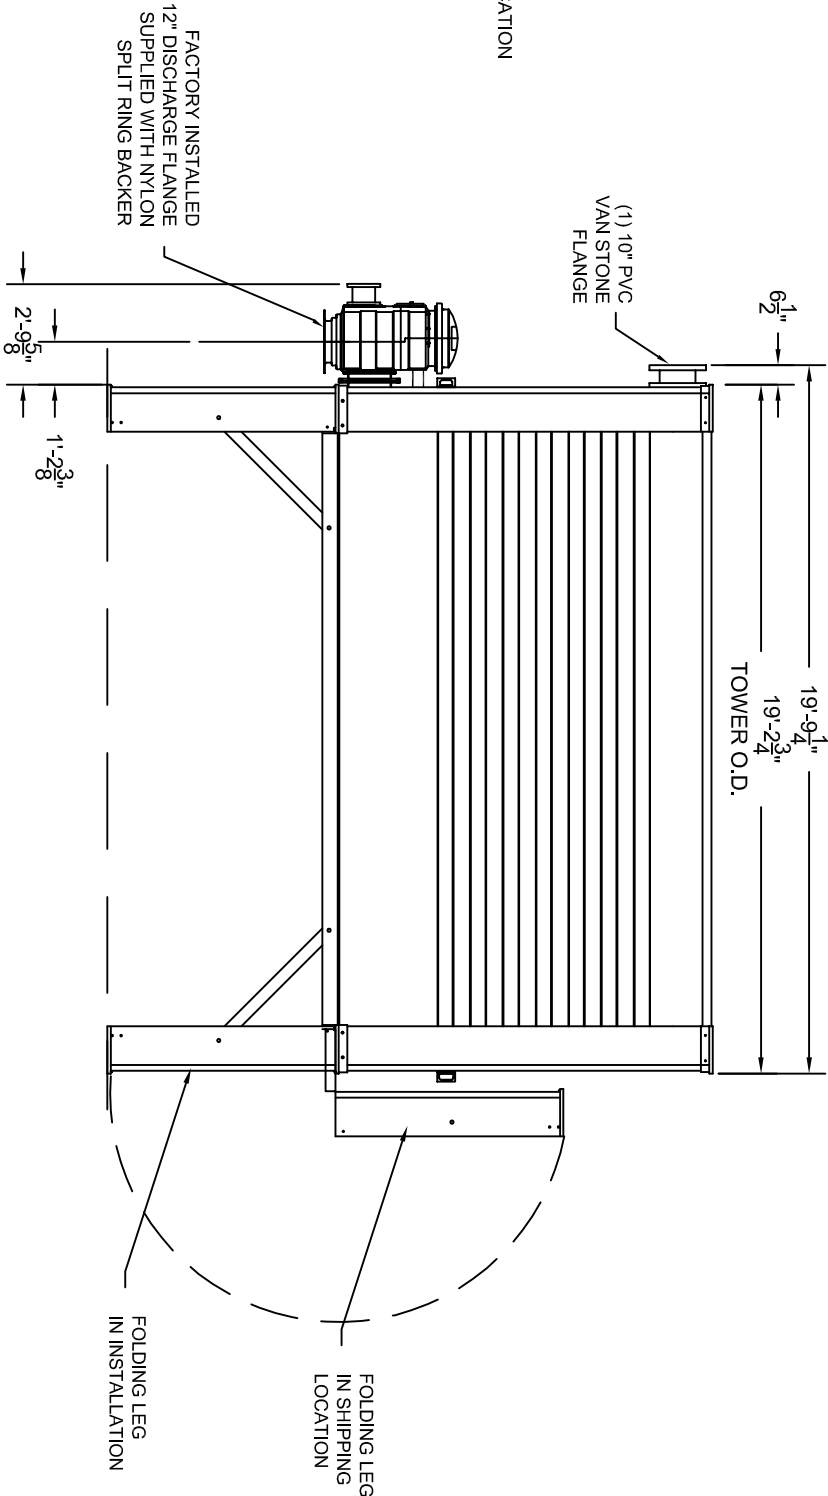

**TOWER TECH**

TELEPHONE: (405) 979-2100  
FAX: (405) 979-2131  
E-MAIL: [cad@towertechusa.com](mailto:cad@towertechusa.com)  
WEBPAGE: <http://www.towertechusa.com>  
5400 NW 5th  
OKLAHOMA CITY, OKLAHOMA 73127

Modular  
Fiberglass  
Cooling Tower  
Model # TTXL-0619XX

1-Unit Installation  
TTXL-06 Plan & Elevation  
W/Folding Substructure

© 2001 BY TOWER TECH  
ALL RIGHTS RESERVED

FOR APPROVAL BY		DATE
Tower Tech Design Team		
REVISIONS		
NO.	DATE	REVISION

DATE: 24 APR 19

DRAWING #: XL-06-2

PROJECT #:

CUST PO#:

DRAWN BY: RFB

CHECKED BY:

PLAN & ELEVATION 2

"DRAWING IS FOR REFERENCE PURPOSES ONLY AND NOT TO BE USED FOR CONSTRUCTION"